

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan

“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS 14483 (Part 1) (1997, Reaffirmed 2009): Fertilizer and Chemical Injection System, Part 1: Venturi Injector. ICS 65.060.40



“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

(Reaffirmed 2009)

REAFFIRMED १९०२

IS 14483 (Part 1) : 1997

भारतीय मानक
उर्वरक एवं रासायनिक अन्तःक्षेपण पद्धति
भाग 1 वेनचुरी अन्तःक्षेपक

Indian Standard
**FERTILIZER AND CHEMICAL
INJECTION SYSTEM**

PART 1 VENTURI INJECTOR

ICS 65.060.40

© BIS 1997

**BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002**

September 1997

Price Group 2

AMENDMENT NO. 1 OCTOBER 1998
TO
IS 14483 (Part 1) : 1997 FERTILIZER AND CHEMICAL
INJECTION SYSTEM

PART 1 VENTURI INJECTOR

(Page 1, clause 1.1) — Insert the following new clause after 1.1 and renumber the subsequent clauses:

‘2 REFERENCES

The following Indian Standards contain provisions which, through reference in this text, constitute provisions of this Indian Standard. At the time of publication, the editions indicated were valid. All standards are subject to revision, and parties to agreements based on this Indian Standard are encouraged to investigate the possibility of applying the most recent editions of the standards indicated below:

<i>‘IS No.</i>	<i>Title</i>
2500 (Part 3) : 1995	Sampling inspection procedures : Part 3 Attributes sampling plans indexed by limiting quality (LQ) for isolated lot inspection’

(Page 2, Table 1) — Substitute the following for the existing table:

‘Table 1 Sampling for Type Test
(Clause 6.1)

Clause	Nature of test	No. of Test Specimens	Acceptance Number
(1)	(2)	(3)	(4)
5.1	Resistance of venturi injector to internal hydrostatic pressure	5	0
5.2	Performance test	5	0

[Page 2, clause 6.1.1 (renumbered 7.1.1)] — Substitute the following for the existing clause:

‘7.1.1 If the number of defective specimens in the sample does not exceed the acceptance number specified in Table 1, the sample shall be considered as complying with the requirements of this Indian Standard. If the number of

Amend No. 1 to IS 14483 (Part 1) : 1997

defective specimens in the sample is greater than the acceptance number, the sample shall be considered as not complying with the requirements of this Indian Standard.'

[Page 3, clause 6.2 (renumbered 7.2)] — Substitute the following for the existing clause:

'7.2 When acceptance of manufacturing lot or shipment is required the sampling shall be done according to IS 2500 (Part 3), based on AQL 2.5 and special inspection level S-4.

If the number of defective specimens in the sample does not exceed the acceptance number specified in IS 2500 (Part 3), the lot or shipment shall be considered as acceptable. If the number of defective specimens in the sample is greater than the acceptance number, the lot or shipment shall be rejected.'

(FAD 54)

AMENDMENT NO. 2 FEBRUARY 2006
TO
IS 14483 (PART 1) : 1997 FERTILIZER AND
CHEMICAL INJECTOR SYSTEM
PART 1 VENTURI INJECTOR

(Page 2, clause 4.3, line 1) — Substitute 'may' for 'shall'.

(Page 2, clause 5.2.1(i), line 1) — Substitute the following for the existing text:-

'The test liquid shall be water. The manufacturer shall declare the value with water as injecting liquid. The manufacturer shall provide a separate table showing the change in suction rate as per density of stock solution.'

(FAD 17)

FOREWORD

This Indian Standard was adopted by the Bureau of Indian Standards, after the draft finalized by the Irrigation and Farm Drainage Equipment and System Sectional Committee had been approved by the Food and Agriculture Division Council.

The application of fertilizer materials or/and other chemicals through irrigation water to crop plant is based on the principle that a swiftly moving stream of water is able to carry with it the dissolved substances and fine dispersed suspended particles of materials. Venturi Injector is one of the appliance used for this purpose.

Venturi Injector operates on the principle that when a pressurized operating (motive) fluid enters the injector it is constricted towards the injection chamber and changes into a high velocity jet stream. The increase in velocity inside the injection chamber results in decrease in pressure, thereby enabling an additive liquid material to be drawn through the suction port and entrained into the motive stream. As the jet stream is diffused toward the injector outlet, its velocity is reduced and there will be a pressure drop at the outlet. In order to standardize the requirements of this appliance for the benefit of manufacture as well as users this standard has been developed. While part 1 of this standard covers the requirement of venturi injector, the part 2 will cover the requirements of ferti-injector pump.

The figures given in the standard are only for illustrations showing typical installation of venturi injectors in the main line.

For the purpose of deciding whether a particular requirement of this standard is complied with the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS 2 : 1960 'Rules for rounding off numerical values (*revised*)'. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

Indian Standard

FERTILIZER AND CHEMICAL INJECTION SYSTEM

PART 1 VENTURI INJECTOR

1 SCOPE

1.1 This standard prescribes the requirements of Venturi Injectors used for injecting fertilizer and chemicals in the sprinkler and drip irrigation systems.

2 TERMINOLOGY

For the purpose of this standard the following definitions shall apply.

2.1 Venturi Injector

An appliance used for fertigation or chemigation, chlorinating or injecting other chemicals in the sprinkler and drip irrigation systems.

2.2 Nominal Size

A conventional numerical designation used to indicate the inlet and outlet size of the Venturi Injector. This designation equals the nominal size of the pipe to which the Venturi Injector can be connected without intermediate fittings.

2.3 Suction Port

The port of the Venturi Injector body through which chemical or additive solution is drawn into the Venturi Injector.

2.4 Check Valve or Non Return Valve

A valve which permits flow in one direction only and prevents reversal of flow by means of an automatic check mechanism. The valve opens by the flow of liquid and closes by the weight of the check mechanism or mechanical pressure (for example spring) when the flow ceases.

2.5 Metering Device

A device for adjusting the flow of chemical and additive solution drawn through the Venturi Injector's suction port during operation and thus calibrates the rate of dosing or injection.

2.6 Venturi Injector Inlet

Side through which the motive fluid enters the Venturi Injector body.

2.7 Venturi Injector Outlet

Side through which the motive fluid mixes with chemicals or other additives flows out.

2.8 Pressure Reducing Device

A device which operates manually or automatically to create a pressure difference between the inlet and outlet.

2.9 Flow Control Device

A device used for controlling or adjusting the flow by which pressure difference is created between the inlet and outlet.

2.10 Motive Flow

Rate of flow of motive fluid through the Venturi Injector measured at the inlet and expressed in l/h.

2.11 Suction Rate

Rate at which the chemicals or other additive solutions are drawn into the Venturi Injector through the suction port during operation expressed in l/h.

2.12 Maximum Operating Pressure

It is the maximum pressure allowed at the inlet of injector assembly expressed in head of water column in metres or kPa.

2.13 Minimum Operating Pressure

It is a minimum water pressure at the outlet of the injector assembly required to operate the injection system, often termed as outlet pressure expressed in head of water column in metres or kPa.

2.14 Suction Operating Range for Venturi Injection System

It is the difference between the maximum operating pressure and minimum operating water pressure.

2.14.1 Percentage of Injection Efficiency

It is the suction operating range for Venturi Injection system divided by maximum operating pressure and multiplied by hundred.

2.15 Injector Efficiency

The ability to create a vacuum with minimal differential pressure (P).

2.16 Minimum Flow (Optimal), Q_{min}

The lowest flow rate at the inlet to the pump at which the pump begins to operate normally as a

function of the pressure at the inlet and the suction flow rate.

2.17 Maximum Flow Rate, Q_{max}

The highest flow rate at the inlet to the pump which is permitted by the manufacturer for its operation.

3 MATERIAL

3.1 The Venturi Injector parts that are in contact with water shall be of non toxic materials and shall be resistant to or protected against degradation caused by operating conditions and types of water, chemicals or other additive solutions used in agricultural irrigation or used for cleaning the system.

3.2 The Venturi Injector body and other parts shall also be resistant to environmental factors like ultraviolet radiation, peak outdoor temperature, corrosion, etc.

4 CONSTRUCTIONAL REQUIREMENTS

4.1 The construction of Venturi Injector shall be such that proper installation in its intended location is feasible. It should be easily detachable for removal when not in use as a precautionary measure against theft or vandalism.

4.2 Suction port shall have suitable connection preferably barbed type to connect suction pipe made of soft and flexible plastic.

4.3 An inbuilt check valve (see 2.4) shall be provided in the suction port to prevent entering of water from the main stream to the chemical or fertilizer.

4.4 A metering device (see 2.5) shall be provided in the suction hose for adjusting the flow of chemicals through the suction port.

4.5 A suction kit assembly comprising of non collapsible and flexible plastic hose of suitable length and a suction strainer made of non corrosive material shall be provided. Suction strainer may be fitted to the suction hose pipe with the help of barbed connection or quick coupling attachment.

4.6 A pressure reducing device or flow control valve is provided on the main line between the inlet and outlet connections.

5 TESTS

5.0 All tests shall be performed with water or test liquid wherever specified at a temperature of $27^{\circ}\text{C} \pm 3^{\circ}\text{C}$. The accuracy of instruments used for measuring various parameters shall be within ± 2 percent of the actual values.

5.1 Resistance of Venturi Injector to Internal Hydrostatic Pressure

This test shall be performed on the Venturi Injector with all its parts assembled for normal operation. Close the outlet of the Venturi Injector by suitable means. Inject water at pressure through the inlet. Raise the pressure gradually to 1.6 times the declared maximum operating pressure and maintain it for one minute.

5.1.1 The Venturi Injector shall withstand the test pressure without suffering damage or deformation.

5.2 Performance Test

Install the venturi injector on a by-pass line connecting main system flow pipeline (see Fig. 1). Create pressure difference between the inlet and the outlet with the help of pressure reducing device or flow control valve. Water suction should be measured at zero lift.

5.2.1 Measure the followings and cross check with the data supplied by the manufacturer. A variation of ± 10 percent shall be accepted from the declared values.

- i) Motive flow (water) and suction rate of test liquid prepared by mixing 2 kg of Urea in 10 litre of water at various pressure difference between the inlet and outlet.
- ii) Minimum pressure drop at which the liquid fluid (water) is drawn through the suction port in relation to inlet pressure specified by the manufacturer.

6 SAMPLING AND ACCEPTANCE

6.1 Type Test

The samples shall be selected at random from a total of minimum 50 Venturi Injectors. The number of test specimens required for each test shall be as specified in Table 1.

6.1.1 If the number of defective specimens in the sample is equal to or less than the acceptance number shown in the above table, the lot shall be considered acceptable. If the number of defective specimens is greater than the acceptance number, the lot shall be rejected.

Table 1 Sampling for Type Testing
(Clause 6.1)

Clause	Nature of Test	No. of Test Specimens	Acceptance Number
5.1	Resistance of Venturi Injector to internal hydrostatic pressure	5	3
5.2	Performance test	5	3

6.2 Acceptance Test

When acceptance of manufacturing lots is required, the testing authority shall determine the number of test specimen and the acceptance number.

7 MARKING

7.1 Each Venturi Injector shall bear a readily visible durable marking incorporating following particulars:

- a) Name of manufacturer and/or his registered trade mark.
- b) Model identification.
- c) Nominal size.
- d) Maximum operating pressure.
- e) Arrow mark to indicate the direction of motive flow.

7.2 BIS Standard Marking

Each Venturi Injector may also be marked with BIS Standard Mark.


7.2.1 The use of the Standard mark is governed by the provisions of *Bureau of Indian Standards Act, 1986* and the Rules and Regulations made there-under. The details of conditions under which the licence for the use of Standard Mark may be granted

to manufacturers or producers may be obtained from the Bureau of Indian Standards.


8 INFORMATION TO BE SUPPLIED BY THE MANUFACTURER

8.1 The manufacturer shall supply the following information about the Venturi Injector:


- a) Name and address of manufacturer.
- b) Model and catalog number of Venturi Injector.
- c) Venturi Injector performance data:
 - i) Table showing motive flow and liquid suction at various differential pressures.
 - ii) Minimum differential pressure between inlet and outlet for working of the venturi injector.
 - iii) Maximum safe operating pressure at the inlet.
 - iv) Type of connection to piping net work.
 - v) Instructions for assembly and operation.
 - vi) List of spare parts.
 - vii) Resistance to Chemicals commonly used during irrigation as well as cleaning.

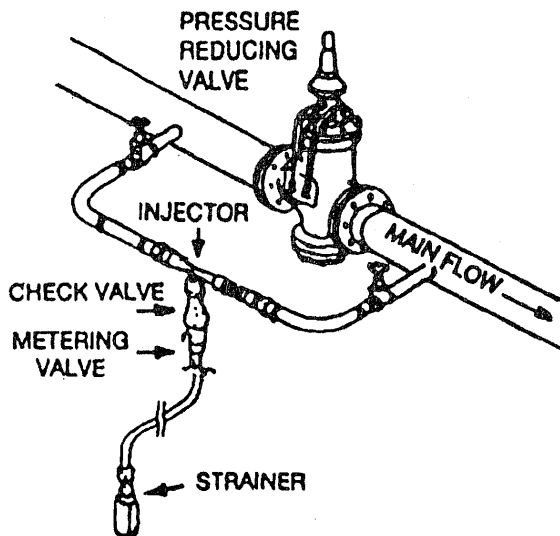


1 A REGULATOR VALVE INSTALLED IN BETWEEN THE INLET AND OUTLET CONNECTIONS OF THE VENTURI INJECTOR CREATES DIFFERENTIAL PRESSURE AND FINALLY VACUUM NEAR THE SUCTION PORT.

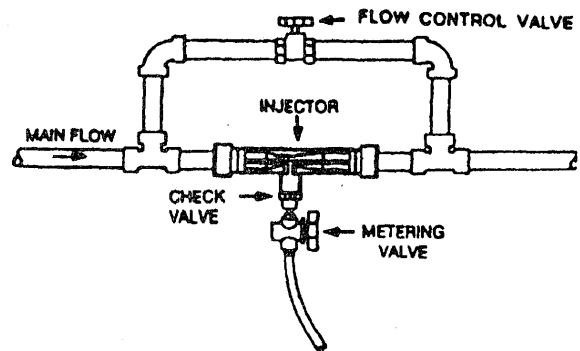

3 INJECTOR CAN BE INSTALLED DIRECTLY IN THE MAIN LINE WITH A BY-PASS CONNECTION HAVING FLOW CONTROL VALVE. WHEN INJECTION IS NOT REQUIRED MAIN FLOW CAN BE DIVERTED THROUGH THE BY-PASS IN TO THE SYSTEM.

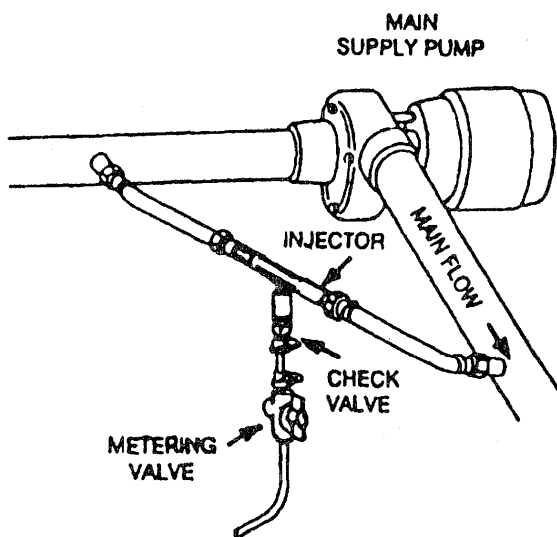

2 INLET OF THE VENTURI CONNECTED TO THE SUCTION PIPE OF A PUMP AND THE OUTLET CONNECTED TO THE DELIVERY PIPE OF THE PUMP. PRESSURE DIFFERENTIAL IS CREATED AUTOMATICALLY WHEN THE PUMP STARTS RUNNING

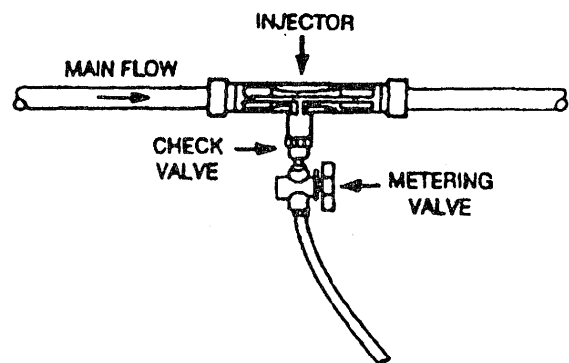

4 INSTALLED IN THE MAIN FLOW LINE TOTAL FLOW OF THE SYSTEM GOES THROUGH THE INJECTOR.

FIG. 1 ILLUSTRATIONS SHOWING TYPICAL INSTALLATIONS OF VENTURI INJECTOR

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act*, 1986 to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in the course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publication), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Handbook' and 'Standards Monthly Additions'.

This Indian Standard has been developed from Doc: No. FAD 54 (497).

Amendments Issued Since Publication

Amend No.	Date of Issue	Text Affected

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002
Telephones: 323 01 31, 323 33 75, 323 94 02

Telegrams: Manaksanstha
(Common to all offices)

Regional Offices:

Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg
NEW DELHI 110002

Eastern : 1/14 C.I.T. Scheme VII M, V.I.P. Road, Maniktola
CALCUTTA 700054

Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022

Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600113

Western : Manakalaya, E9 MIDC, Marol, Andheri (East)
MUMBAI 400093

Telephone
323 76 17, 323 38 41

{ 337 84 99, 337 85 61
{ 337 86 26, 337 91 20

{ 60 38 43
{ 60 20 25

{ 235 02 16, 235 04 42
{ 235 15 19, 235 23 15

{ 832 92 95, 832 78 58
{ 832 78 91, 832 78 92

Branches : AHMADABAD. BANGALORE. BHOPAL. BHUBANESHWAR.
COIMBATORE. FARIDABAD. GHAZIABAD. GUWAHATI.
HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR.
PATNA. PUNE. THIRUVANANTHAPURAM.